


CONNECTORS SHALL BE SNAKE
BITE OR APPROVED EQUAL

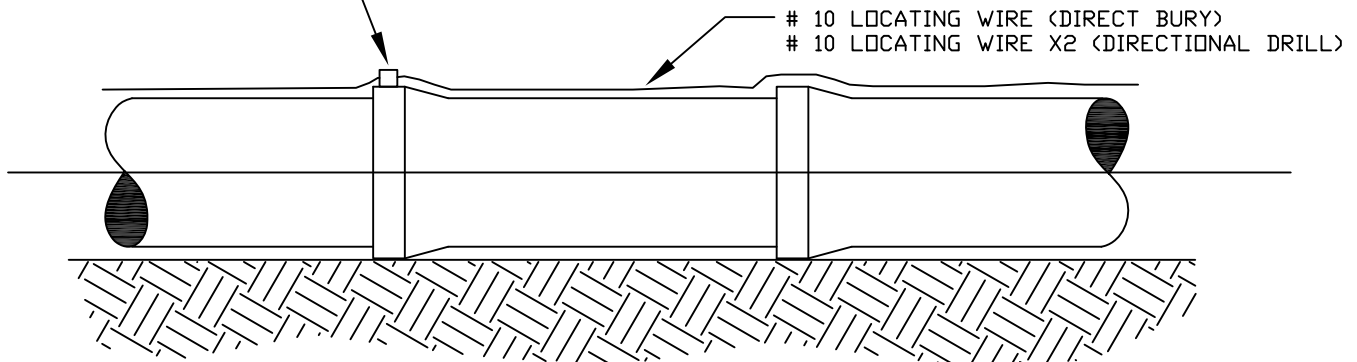

NOTES:

1. ALL PIPE SHALL REQUIRE INSULATED METALLIC SOLID LOCATING WIRE CAPABLE OF DETECTION BY A CABLE LOCATOR AND SHALL BE BURIED DIRECTLY ABOVE CENTERLINE OF PIPE.
2. LOCATING WIRE SHALL TERMINATE AT THE TOP OF EACH VALVE BOX AND BE CAPABLE OF EXTENDING 12" ABOVE TOP OF BOX IN SUCH A MANNER SO AS NOT TO INTERFERE WITH VALVE OPERATION (SEE GATE VALVE AND BOX DETAIL, FIGURE 2307).
3. ADHESIVE I.D. TAPE AS NECESSARY TO HOLD WIRE DIRECTLY ON THE TOP OF THE PIPE.
4. LOCATE WIRE AND LOCATE TAPE (TWO TYPES) SHALL BE ON ALL PIPES.
5. DIRECTIONAL DRILL INSTALLATION SHALL USE TWO SEPARATE COPPER CLAD SOLID STEEL WIRES, 10 GAUGE.
6. CONNECTIONS SHALL BE SNAKE BITE CONNECTORS, OR APPROVED EQUAL
7. REFER TO VOLUSIA COUNTY ELECTRONIC BALL DETAIL

PIPE LOCATING DETAIL

N.T.S.